


OR



NOTE: LOW SHRINK CONCRETE 2mpa – SLUMP 75–125mm

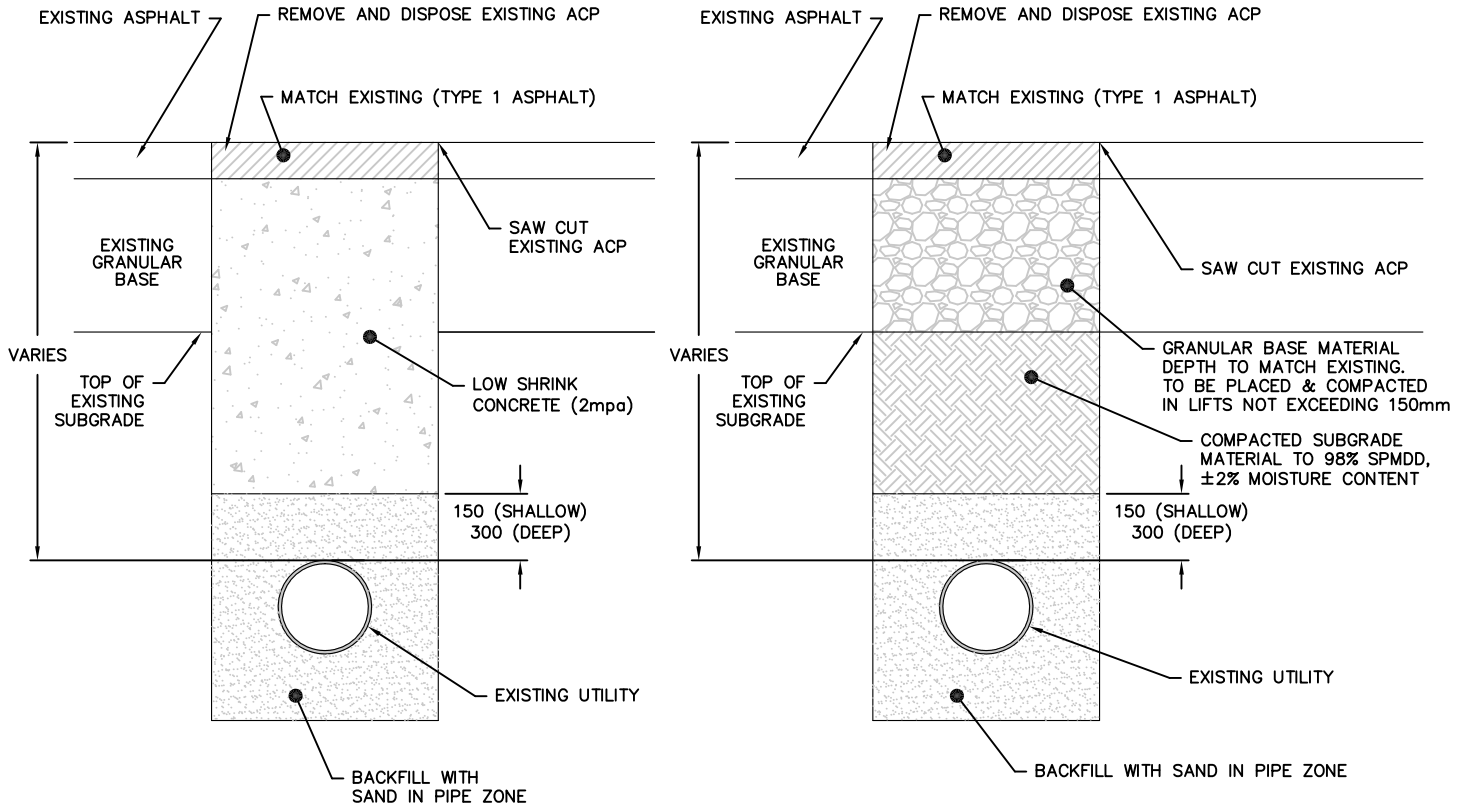

CITY OF  
*Lethbridge*

INFRASTRUCTURE SERVICES

TYPICAL DETAIL BACKFILLING  
HYDROVAC < (1.0m x 1.0m)  
THROUGH EXISTING ROADWAYS

DRAWN:	R.J.K.
DESIGN:	R.J.K.
CHECKED:	R.A.B.
APPROVED:	D.L.J.
SCALE:	N.T.S.
DATE:	20/04/2011
DWG NO:	str_34

DATE	REVISION	BY
FILE:	Backfill.dwg	